

Data Sheet CODESYS Application Composer

The CODESYS Application Composer enables, for modular machines, the efficient, no-code creation and complete generation of suitable control applications of all sizes by combining and parameterizing multi-modal software modules.

Product description

With CODESYS Application Composer, complete control applications can be customized from previously created software modules, i.e., assembled and parameterized.

Composer modules are functional program units that can correspond to both machine or plant components and to software functions. For each unit, they combine all software aspects offered by CODESYS in a multi-modal software module: the program code for the unit, parameterization and combination options, the unit's I/O level (devices and I/O assignment), visualization, alarms, and traces of the unit.

With purchasing a functional license you acquire the possibility to create and use new modules or module declarations within the CODESYS Development System.

Functions


The customization of the modules takes place in the module tree. In the process each entry corresponds to a module instance. In the insertion of new elements into the module structure only suitable modules are offered for selection. In the module properties the parameterization, the I/O configuration and the visualization selection are defined for the module instances. Simultaneously the configuration of sequencer modules can take place with the help of an easy-to-use sequence editor. From the module configuration a menu command generates the complete application code including visualization and I/O configuration. Application-specific code can be added in the form of extension modules and remains unchanged if the code is generated again.

The creation of modules takes place in the form of module declarations which can be added as objects in the POU pool (see Picture 1).

```
HumiditySensor X
 AC_ModuleAlarming
                                                                  MODULE HumiditySensor IMPLEMENTED BY HumiditySensor
     A Error
                                                                   SEC std.MetaData
                                                                       Desc
                                                                                  := TL.HumiditySensor Desc ;
     Storage
                                                                       Category
                                                                                 := 'Misc' ;
     AirState (STRUCT)
                                                                       Icon_16
                                                                                 := IP.HumiditySensor_Icon_16 ;
      AC_Std
                                                                       Icon_32
                                                                                 := IP.HumiditySensor_Icon_32 ;
   Conditioners
                                                                  END SEC
   🗓 🧀 Controllers
                                                         Ξ
                                                                   SEC alg.Alarm
   Functions
                                                         SEC SetAlarm : ValueRange
   🚊 🧀 Sensors
                                                             10
                                                                           Class := Error;
      HumiditySensor
                                                             11
                                                                           Message := TL.Alarm_Humidity;
           IHumiditySensor
                                                             12
                                                                           LatchVar1 := rAlarmValueLow;
                                                             13
                                                                           LatchVar2 := rAlarmValueHigh;
           HumiditySensor
                                                                           ModuleCalls := THIS | PARENTS;
           HumiditySensor (FB)
                                                             15
                                                                           SEC OutsideRange
           HumiditySensor_Emb
                                                             16
                                                                               Expression := 'rValue';
      PressureSensor
                                                                               AreaLow := 'rAlarmValueLow';
      TemperatureSensor
                                                                               LowIncludeBorder := TRUE;
      ⊞ ⊶○ ISensor
                                                             19
                                                                               HighIncludeBorder := TRUE;
      Sensor (FB)
                                                             20
                                                                               AreaHigh := 'rAlarmValueHigh';
     GlobalTextList
                                                             21
                                                                           END_SEC
                                                             22
                                                                       END SEC
                                                             23
                                                                  END SEC
     ■ IP
                                                             2.4
                                                                  SEC std.Parameters
     🎁 Library Manager
                                                             2.5
                                                                       SEC Param : rAlarmHumidityHigh
     ProcessSystem
                                                             26
                                                                           Variable := rAlarmValueHigh;
     ProcessSystem (FB)
                                                             21
                                                                           Name := TL.Name_rAlarmHumidityHigh;
        CallPrioMEDIUMStart
                                                             28
                                                                           Desc := TL.Desc_rAlarmHumidityHigh;
        Init
                                                             29
                                                                       END SEC
     Project Information
                                                             30
                                                                       SEC Param : rAlarmHumidityLow
     ·□Ì TL
                                                             31
                                                                           Variable := rAlarmValueLow;
                                                             32
                                                                           Name := TL.Name_rAlarmHumidityLow;
     ProcessSystem
                                                             33
                                                                           Desc := TL.Desc_rAlarmHumidityLow;
     Project Settings
                                                             34
                                                                       END_SEC
                                                             35
                                                                  END SEC
                                                             36
                                                                  SEC std.Visu
                                                             37
                                                                       Embedded := [HumiditySensor_Emb];
                                                                  END_SEC
Modules
```


Picture 1: Module declaration

Each module declaration requires the specification of a function module (Modul-FB) as a basis, implementing the program functionalities of the module. Within the module declaration the module FB can be supplemented by additional properties and associated objects: * Parameters: Input variables of the module FB can be designated as parameters. Parameters are then conveniently configured within a parameter module editor (see Picture 2).



Picture 2: Parameter editor


Inputs/Outputs: Input and output variables of the module FB can be defined as module
inputs and outputs. Input variables of the module FB can be designated as parameters. The
module inputs/outputs can then be conveniently connected to variables, other module
inputs/outputs or device inputs/outputs (see Picture 3).

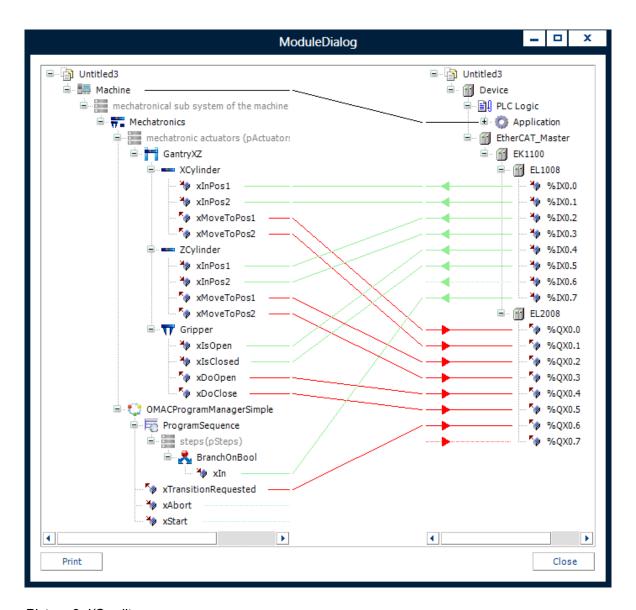

Picture 3: I/O editor

- Slots: Input variables of the module FB can be designated such that they can accept instances of other module FBs. For example, if a module is supposed to be usable as a sub-module beneath another module, a slot is defined in the father module that can accept the corresponding child modules. The associated input variable is then automatically filled with the instances of the child module FBs during the generation.
- Tasks: If it is a top level module (module without a father module), additional tasks can be
 defined that are generated in the generator run and that automatically call specified
 methods of the module FB. A top level module for its part then calls methods of its child
 module FB.
- Visualizations: Each module permits the definition of page and embedded visualizations.
 This will be automatically generated with and connected to the module during generation.
 Page visualizations are displayed explicitly for one module. Embedded visualizations, on the other hand, can be embedded in the page visualizations of father modules.
- Proxy Module FBs: Modules can define so-called proxy representative FBs of their own module FBs. A proxy is used to make possible references on a module FB that go beyond the application and controller boundaries by creating a proxy FB in the respective application as a representative of the referenced module FB. The communication and data

- exchange between the module FB and its proxy FB below a foreign application is automatically generated by the Application Composer generators.
- Instance-References: With so-called instance references you can define FB instances that will not be identified until configuration time of the module by the module user with actual instances. For example device FBs can be referenced in modules as instance references.
- Devices and inputs/outputs: Modules can define devices (e.g. fieldbuses) that are inserted with the module into the device tree. The inputs and outputs of the devices can then be automatically connected to the inputs and outputs of the module or modules. For the greatest possible flexibility the devices can also be inserted as so-called "wildcards" which do not have to be filled with actual device types until the time of generation (see Picture 4).

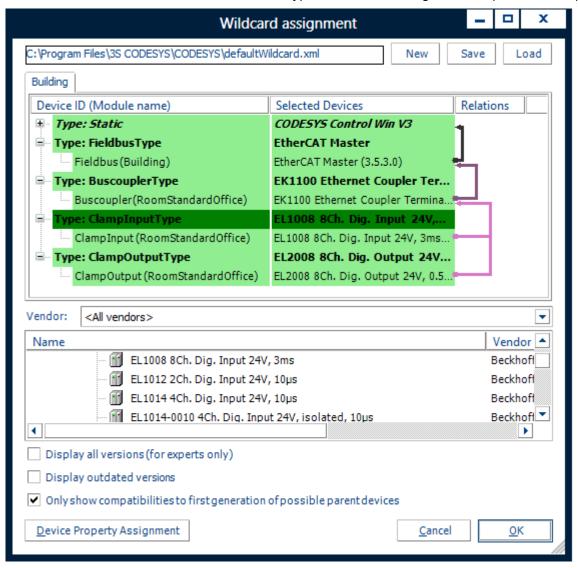

Picture 4: Assignment of module channels to devices

- Alarms: Along with visualizations and devices, modules can also use the CODESYS alarm management in order to generate alarms for variables of their module FBs. These alarms can be displayed as well as intercepted and evaluated via a call mechanism.
- Sequence module designation: If modules in the form of sequences are supposed to be editable, this can be defined via the module declaration. Parameters, inputs/outputs or references can be specified which are then displayed directly in the sequence steps.

• Default Submodules: Default assignments and default configurations can be specified for module slots (see above). In the insertion of the module such a default assignment then fills the module slot automatically with the predefined module, which can be correspondingly configured. After the declaration of the modules and the implementation of the associated module FB, these modules can be inserted into the module tree and configured. In order to finally obtain a functional IEC application only a generator run has to be performed.
Depending on the selection of generators and configuration, in the generator run the complete IEC code, visualizations, devices etc. are generated beneath an application. The entire generated code, or all objects created in the process can be freely viewed and edited under the device tree.

General information

Supplier:

CODESYS GmbH Memminger Strasse 151 87439 Kempten Germany

Support:

Technical support is not included with this product. To receive technical support, please purchase a CODESYS Support Ticket.

https://support.codesys.com

Item:

CODESYS Application Composer

Item number:

Composer S (100 Module Instances): 2111000030

Composer M (500 Module Instances): 2111000031

Composer L (2500 Module Instances): 2111000032

Composer XL (12500 Module Instances): 2111000033

Sales/Source of supply:

Package: CODESYS Installer

License: CODESYS Sales (sales@codesys.com)

Included in delivery:

CODESYS Package via CODESYS Installer

System requirements and restrictions

Programming System	CODESYS Development System 3.5.19.30 or higher
Runtime System	CODESYS Control Version 3.5.0.0
Supported Platforms/ Devices	Note: Use the project "Device Reader" to find out which functions are supported by the controller. "Device Reader" is available for free in the CODESYS Store.
Additional Requirements	-
Restrictions	Without a valid license the CODESYS Application Compser is only very limited usable.
Licensing	Performance class licenses require a CODESYS Application Composer 4.4.0.0 or later.

Licensing is done via the CODESYS License Provider mechanism and requires the following packages:

- CODESYS License Provider >= 1.1.0.0
- CODESYS License Provider Enabler >= 1.1.0.0
- CODESYS Licensing Support >= 1.1.0.0

These are automatically solved and installed by the CODESYS installer during installation.

The activation of the licenses is done via UFC license container (soft container or USB dongle) and is available as a workstation license. By simply reconnecting the CODESYS key, the license can be used at another workstation.

The annual subscription is available as a workstation license.



Required Accessories

Optional: CODESYS Key

Note: Technical specifications are subject to change. Errors and omissions excepted. The content of the current online version of this document applies.

Creation date: 2025-09-12